




Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.

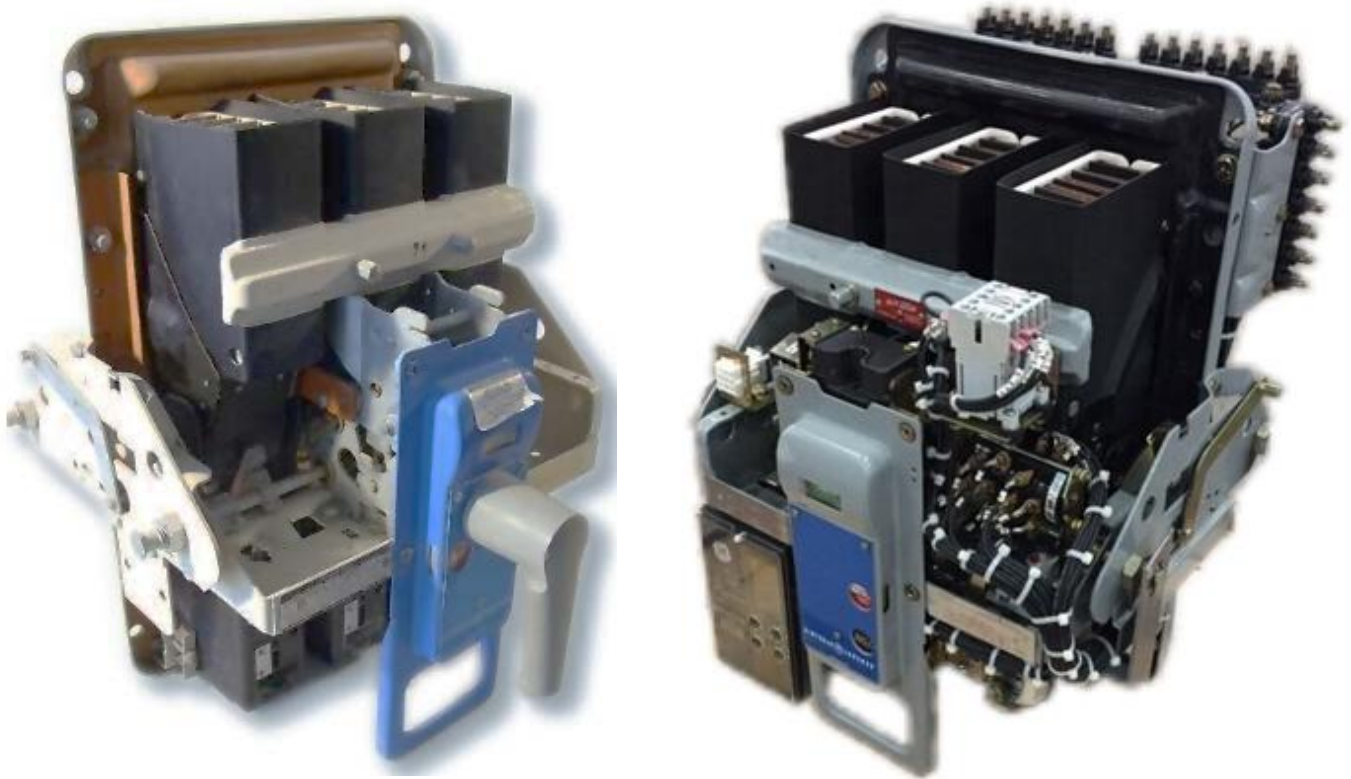





AK-25
Maintenance Manual - GEH 50299E
Renewal Parts - GEF 4149H

Part Number	Description	Qty
Disconnects		
192A9669P1	Primary Disconnect Finger (individual)	24
386A110G2	Breaker Secondary Disconnect	1
0176D7926G001	Equipment Secondary Disconnect	1
Contacts		
805B910G1	Stationary Main Contact - Left	3
805B910G2	Stationary Main Contact - Right	3
269C257G15	Movable Main Contact Assembly	3
269C277G1	Crossbar Assembly	1
Charging		
669D807P1	Charging Handle	1
622C505G1	Cut-off Switch	1
Relays		
10083623G12	125VDC Anti-Pump Y-Relay	1
10083623G13	250VDC Anti-Pump Y-Relay	1
10083623G14	120VAC Anti-Pump Y-Relay	1
10083623G16	240VAC Anti-Pump Y-Relay	1
Arc Quenchers		
293B288G2	Arc Quencher (post 1988)	3
AKO25AQR1G1	Non-Asbestos Arc Quencher (breakers Produced Prior to 1988)	1



Part Number	Description	Qty
Close		
366A773G13	125VDC Closing Solenoid Coil	1
366A773G15	250VDC Closing Solenoid Coil	1
366A773G1	120VAC/60Hz Closing Solenoid Coil	1
366A773G4	240VAC/60Hz Closing Solenoid Coil	1
192A9770P4	120VAC/60Hz Closing X- Relay	1
192A9770P8	240VAC/60Hz Closing X- Relay	1
Trip		
AKO25C3F0604A	Entelliguard Conversion Kit (Flux Shifter, CTs, Trip Unit & Wire Harness)	1
Accessories		
139C4378G4	125VDC Shunt Trip Device	1
K6275081G29	125VDC Shunt Trip Coil	1
184L701BAG7	Bell Alarm 1NO/1NC	1
568B309G3	125VDC Under Voltage Module	1
K6275081G18	125VDC UVD Coil Only	1
568B309G7	120VAC/60Hz Under Voltage Device	1
K6275081G26	120VAC/60Hz UVD Coil Only	1
568B309G24	230VAC/50Hz Under Voltage Device	1
K6275081G59	230VAC/50Hz UVD Coil Only	1
568B309G13	240VAC/60Hz Under Voltage Device	1
K6275081G7	240VAC/60Hz UVD Coil Only	1
184L701AUG13	Aux Switch Assembly (5 Stage)	1

New Replacement Circuit Breaker

AK-25 MAN AKD5&6	AK-11A-25 Manually Operated Breaker with Shunt trip, Bell Alarm, 5 Stage Aux Switch
AK-25 E/O 125v AKD5&6	AK-11A-25 Electrically Operated Breaker with Shunt trip, Bell Alarm, Under Voltage Device, 5 Stage Aux Switch
AK-25 E/O 120V AKD5&6	AK-11A-25 Electrically Operated Breaker with Shunt trip, Bell Alarm, Under Voltage Device, 5 Stage Aux Switch



Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.






AKR-30
Maintenance Manual - GEK 64459D
Renewal Parts - GEF 4527





Part Number	Description	Qty	Part Number	Description	Qty
Disconnects			Close		
192A9669P1	Primary Disconnect Finger (individual)	4	192A9794P2	125VDC Closing Solenoid	1
386A110G2	Breaker Secondary Disconnect	1	192A9794P4	120VAC/60Hz Closing Solenoid	1
0176D7926G001	Equipment Secondary Disconnect	1	192A9794P7	240VAC/50Hz Closing Solenoid	1
Contacts			192A9770P4	120VAC/60Hz Closing X- Relay	1
192A9847G1	Stationary Arcing Contact	6	192A9770P8	240VAC/60Hz Closing X- Relay	1
192A9847G2	Stationary Main Contact	9	Trip		
192A9511G3	Movable Main Contact	3	AKR30C3F0804A	Entelliguard Conversion Kit (Flux Shifter, CTs, Trip Unit & Wire Harness)	1
Charging			Accessories		
286A8096G1	Charging Handle	1	139C4378G4	125VDC Shunt Trip Device	1
568B596G4	48VDC Charging Motor	1	K6275081G29	125VDC Shunt Trip Coil Only	1
568B596G5	110VAC/125VDC Charging Motor	1	139C4378G5	250VDC Shunt Trip Device	1
568B596G6	240VAC/250VDC Charging Motor	1	K6275081G30	250VDC Shunt Trip Coil Only	1
192A7153P8	"F" Cut-off Switch	1	139C4378G7	120VAC/60Hz Shunt Trip Device	1
192A7153P7	"G" Cut-off Switch	1	K6275081G25	120VAC/60Hz Shunt Trip Coil Only	1
343L731G1	Charging Gear	1	139C4378G13	240VAC/60Hz Shunt Trip Device	1
323A6081G1	Holding Pawl Kit	1	K6275081G26	240VAC/60Hz Shunt Trip Coil	1
Arc Quenchers			139C4625G4	Bell Alarm 1NO/1NC	1
425D404G2	Arc Quencher (post 1988)	3	568B309G3	125VDC Under Voltage Device	1
AKR30AQR1G1	Non-asbestos Arc Quencher (breakers Produced Prior To 1988)	1	K6275081G18	125VDC UVD Coil Only	1
Racking Mech			568B309G7	120VAC/60Hz Under Voltage Device	1
139C4618G1	Racking Mechanism	1	K6275081G26	120VAC/60Hz UVD Coil Only	1
Mechanism			568B309G13	240VAC/60Hz Under Voltage Device	1
139C4616G5	Complete Front Mechanism (manual)	1	K6275081G7	240VAC/60Hz UVD Coil Only	1
139C4616G6	Complete Front Mechanism (electrical)	1	568B309G24	230VAC/60Hz Under Voltage Device	1
			K6275081G59	230VAC/60Hz UVD Coil Only	1
			568B571G14	Aux Switch Assembly (6 Stage)	1

New Replacement Circuit Breaker

AKR-30 E/O 125V AKD5&6	AKR-11A-30 Electrically Operated Breaker with Shunt trip, Bell Alarm, Under Voltage Device, 6 Stage Aux Switch
AKR-30 E/O 125V AKD8	AKR-11D-30 Electrically Operated Breaker with Shunt trip, Bell Alarm, Under Voltage Device, 6 Stage Aux Switch
AKR-30 E/O 120V AKD8	AKR-11D-30 Electrically Operated Breaker with Shunt trip, Bell Alarm, Under Voltage Device, 6 Stage Aux Switch



Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.

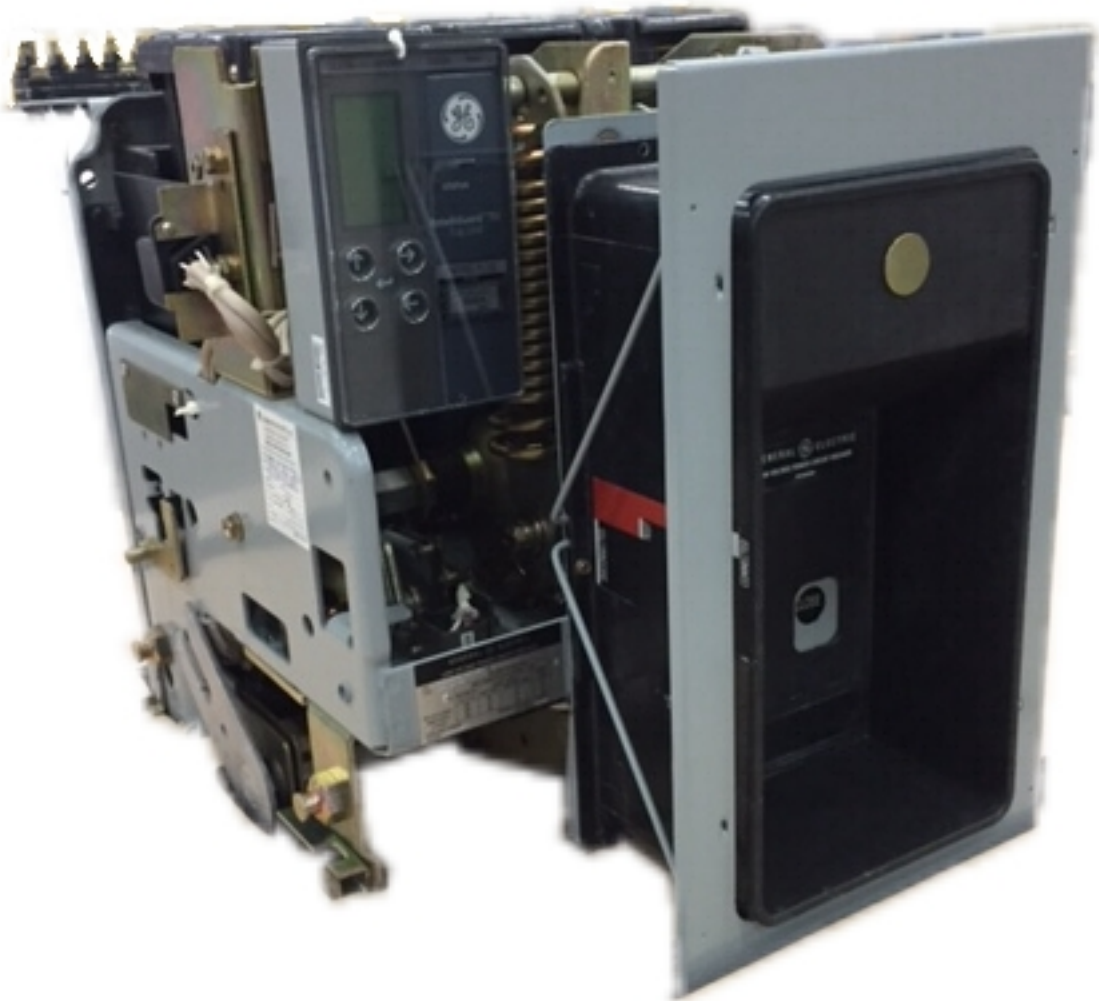




AKR-50
Maintenance Manual - GEK 64459D
Renewal Parts - GEF 4527

Part Number	Description	Qty
Disconnects		
192A9669P1	Primary Disconnect Finger (individual)	8
386A110G2	Breaker Secondary Disconnect	1
0176D7926G001	Equipment Secondary Disconnect	1
Contacts		
568B509G6	Stationary Arcing Contact - Left	3
568B509G6	Stationary Arcing Contact - Right	3
192A9505G2	Stationary Intermediate Contact	6
192A9505G1	Stationary Main Contact	18
192A9511G1	Movable Main Contact - Left	3
192A9511G2	Movable Main Contact - Right	3
Charging		
568B386G1	Charging Handle	1
568B596G4	48VDC Charging Motor	1
568B596G5	110VAC/125VDC Charging Motor	1
568B596G6	240VAC/250VDC Charging Motor	1
192A7153P8	"F" Cut-off Switch	1
192A7153P7	"G" Cut-off Switch	1
343L731G1	Charging Gear	1
323A6081G1	Holding Pawl Kit	1
Arc Quenchers		
425D404G1	Arc Quencher (post 1988)	3
AKR50AQR1G1	Non-asbestos Arc Quencher (breakers Produced Prior to 1988)	1
Racking Mech		
139C4618G1	Racking Mechanism	1
Mechanism		
139C4616G5	Complete Front Mechanism (manual)	1
139C4616G6	Complete Front Mechanism (electrical)	1




Part Number	Description	Qty
Close		
192A9794P12	125VDC Closing Solenoid	1
192A9794P14	120VAC/60Hz Closing Solenoid	1
192A9770P4	120VAC/60Hz Closing X- Relay	1
192A9770P8	240VAC/60Hz Closing X- Relay	1
Trip		
AKR50C3F1604A	Entelliguard Conversion Kit (Flux Shifter, CTs, Trip Unit & Wire Harness)	1
Accessories		
139C4378G4	125VDC Shunt Trip Device	1
K6275081G29	125VDC Shunt Trip Coil Only	1
139C4378G5	250VDC Shunt Trip Device	1
K6275081G30	250VDC Shunt Trip Coil Only	1
139C4378G7	120VAC/60Hz Shunt Trip Device	1
K6275081G25	120VAC/60Hz Shunt Trip Coil Only	1
139C4378G13	240VAC/60Hz Shunt Trip Device	1
K6275081G26	240VAC/60Hz Shunt Trip Coil	1
139C4625G4	Bell Alarm 1NO/1NC	1
568B309G3	125VDC Under Voltage Device	1
K6275081G18	125VDC UVD Coil Only	1
568B309G7	120VAC/60Hz Under Voltage Device	1
K6275081G26	120VAC/60Hz UVD Coil Only	1
568B309G13	240VAC/60Hz Under Voltage Device	1
K6275081G7	240VAC/60Hz UVD Coil Only	1
568B309G24	230VAC/60Hz Under Voltage Device	1
K6275081G59	230VAC/60Hz UVD Coil Only	1
568B571G14	Aux Switch Assembly (6 Stage)	1

New Replacement Circuit Breaker

AKR-50 E/O 125v AKD5&6	AKR-11A-50 Electrically Operated Breaker with Shunt trip, Bell Alarm, Under Voltage Device, 6 Stage Aux Switch
AKR-50 E/O 120V AKD8	AKR-11D-50 Electrically Operated Breaker with Shunt trip, Bell Alarm, Under Voltage Device, 6 Stage Aux Switch
AKR-50 E/O 125v AKD8	AKR-11D-50 Electrically Operated Breaker with Shunt trip, Bell Alarm, Under Voltage Device, 6 Stage Aux Switch



Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.



AKR-75 Maintenance Manual - GEK 64460A Renewal Part - GEF 4552




Part Number	Description	Qty
Disconnects		
192A9669P1	Primary Disconnect Finger (individual)	12
386A110G2	Breaker Secondary Disconnect	1
0176D7926G001	Equipment Secondary Disconnect	1
Contacts		
K9921572G3	Movable Arcing Contact	9
193A1126G7	Movable Intermediate Contact - Right	3
193A1126G10	Movable Main Contact - Left	9
193A1126G8	Movable Main Contact - Right	6
295B408G3	Stationary Arcing Contact	9
193A1127G1	Stationary Intermediate Contact - Right	3
193A1125G2	Stationary Main Contact - Left	9
193A1125G1	Stationary Main Contact - Right	6
Charging		
425D278G1	Charging Mechanism	1
568B596G4	48VDC Charging Motor	1
568B596G5	110VAC/125VDC Charging Motor	1
568B596G6	240VAC/250VDC Charging Motor	1
192A7153P8	"F" Cut-off Switch	1
192A7153P7	"G" Cut-off Switch	1
Relays		
10083623G12	125VDC Anti-Pump W-Relay	1
10083623G13	250VDC Anti-Pump W-Relay	1
10083623G14	120VAC Anti-Pump W-Relay	1
10083623G16	240VAC Anti-Pump W-Relay	1
Arc Quenchers		
161D6507G1	Arc Quencher (post 1988)	3
AKR75AQR1G1	Non-asbestos Arc Quencher (breakers Produced Prior to 1988)	1

Part Number	Description	Qty
Close		
192A9794P12	125VDC Closing Solenoid	1
192A9794P14	120VAC/60Hz Closing Solenoid	1
192A9770P4	120VAC/60Hz Closing X- Relay	1
192A9770P8	240VAC/60Hz Closing X- Relay	1
Trip		
AKR75C3F3204A	Entellguard Conversion Kit (Flux Shifter, CTs, Trip Unit & Wire Harness)	1
Accessories		
139C4378G4	125VDC Shunt Trip Device	1
K6275081G29	125VDC Shunt Trip Coil Only	1
139C4378G5	250VDC Shunt Trip Device	1
K6275081G30	250VDC Shunt Trip Coil Only	1
139C4378G7	120VAC/60Hz Shunt Trip Device	1
K6275081G25	120VAC/60Hz Shunt Trip Coil Only	1
139C4378G13	240VAC/60Hz Shunt Trip Device	1
K6275081G26	240VAC/60Hz Shunt Trip Coil	1
425D305G4	Bell Alarm 1NO/1NC	1
568B309G3	125VDC Under Voltage Device	1
K6275081G18	125VDC UVD Coil Only	1
568B309G7	120VAC/60Hz Under Voltage Device	1
K6275081G26	120VAC/60Hz UVD Coil Only	1
568B309G13	240VAC/60Hz Under Voltage Device	1
K6275081G7	240VAC/60Hz UVD Coil Only	1
568B309G24	230VAC/60Hz Under Voltage Device	1
K6275081G59	230VAC/60Hz UVD Coil Only	1
242B7016P6	Aux Switch Assembly (6 Stage)	1
Interlock		
139C4369G2	Drawout Interlock	1
Racking Mech		
425D293G2	Racking Mechanism	1



New Replacement Circuit Breaker

AKR-11D-75 E/O 120V

AKR-11D-75 Electrically Operated Breaker with Shunt Trip, 5 Stage Aux Switch



Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.






AKR-100

Maintenance Manual - GEK 64460A

Renewal Part - GEF 4552

Part Number	Description	Qty
Disconnects		
192A9669P1	Primary Disconnect Finger (individual)	12
386A110G2	Breaker Secondary Disconnect	1
0176D7926G001	Equipment Secondary Disconnect	1
Contacts		
K9921572G3	Movable Arcing Contact	15
193A1126G9	Movable Intermediate Contact - Left	3
193A1126G7	Movable Intermediate Contact - Right	3
193A1126G10	Movable Main Contact - Left	9
193A1126G8	Movable Main Contact - Right	9
295B408G3	Stationary Arcing Contact	15
193A1127G2	Stationary Intermediate Contact - Left	3
193A1127G1	Stationary Intermediate Contact - Right	3
193A1125G2	Stationary Main Contact - Left	9
193A1125G1	Stationary Main Contact - Right	9
Charging		
425D278G1	Charging Mechanism	1
568B596G4	48VDC Charging Motor	1
568B596G5	110VAC/125VDC Charging Motor	1
568B596G6	240VAC/250VDC Charging Motor	1
192A7153P8	"F" Cut-off Switch	1
192A7153P7	"G" Cut-off Switch	1
Relays		
10083623G12	125VDC Anti-Pump W-Relay	1
10083623G13	250VDC Anti-Pump W-Relay	1
10083623G14	120VAC Anti-Pump W-Relay	1
10083623G16	240VAC Anti-Pump W-Relay	1
Arc Quenchers		
161D6507G2	Arc Quencher (post 1988)	3
AKR10AQR1G1	Non-asbestos Arc Quencher (breakers Produced Prior to 1988)	1

Part Number	Description	Qty
Close		
192A9794P12	125VDC Closing Solenoid	1
192A9794P14	120VAC/60Hz Closing Solenoid	1
192A9770P4	120VAC/60Hz Closing X- Relay	1
192A9770P8	240VAC/60Hz Closing X- Relay	1
Trip		
AKR10C3F4004A	Entellguard Conversion Kit (Flux Shifter, CTs, Trip Unit & Wire Harness)	1
Accessories		
139C4378G4	125VDC Shunt Trip Device	1
K6275081G29	125VDC Shunt Trip Coil Only	1
139C4378G5	250VDC Shunt Trip Device	1
K6275081G30	250VDC Shunt Trip Coil Only	1
139C4378G7	120VAC/60Hz Shunt Trip Device	1
K6275081G25	120VAC/60Hz Shunt Trip Coil Only	1
139C4378G13	240VAC/60Hz Shunt Trip Device	1
K6275081G26	240VAC/60Hz Shunt Trip Coil	1
425D305G4	Bell Alarm 1NO/1NC	1
568B309G3	125VDC Under Voltage Device	1
K6275081G18	125VDC UVD Coil Only	1
568B309G7	120VAC/60Hz Under Voltage Device	1
K6275081G26	120VAC/60Hz UVD Coil Only	1
568B309G13	240VAC/60Hz Under Voltage Device	1
K6275081G7	240VAC/60Hz UVD Coil Only	1
568B309G24	230VAC/60Hz Under Voltage Device	1
K6275081G59	230VAC/60Hz UVD Coil Only	1
242B7016P6	Aux Switch Assembly (6 Stage)	1
Interlock		
139C4369G2	Drawout Interlock	1
Racking Mech		
425D293G3	Racking Mechanism	1





Breaker Express

WP-08 Recommended Spare Parts

Exclusively Licensed Provider of Genuine GE Renewal Parts

Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.




800-727-8443
PartsSuperCenter.com
Sales@PSCparts.com




Transformers



Circuit Breakers
& Switchgear



Industrial Drives
& Controls



Motors

WavePro WP-08
Maintenance Manual - DEH 136
Renewal Parts - DEF 004



Part Number	Description	Qty
Disconnects		
242B7062G1	Primary Disconnect Assembly	6
192A9668G1	Primary Disconnect Finger (WPX-08)	6
10080736G1	Breaker Secondary Disconnect	1
0228C8408G003	Equipment Secondary Disconnect	1
Contacts		
568B509G6	Stationary Arcing Contact - Left & Right	6
192A9505G1	Stationary Main Contact	18
192A9511G1	Movable Contact - Left	3
192A9511G2	Movable Contact - Right	3
Charging		
10060164G2	Charging Handle	1
568B596G4	48VDC Charging Motor	1
568B596G5	110VAC/125VDC Charging Motor	1
568B596G6	240VAC/250VDC Charging Motor	1
192A7153P8	Cut-off Switch	1
343L731G1	Ratchet Assembly	1
323A6080G1	Charging Pawl Kit	1
323A6081G1	Holding Pawl Kit	1
Arc Quenchers		
161D6522G2	Arc Quencher	3
425D404G10	Arc Quencher (WPX-08)	3
Racking Mech		
10060041G1	Racking Mechanism	1
10060041G2	Racking Mechanism (OEM)	1

Part Number	Description	Qty
Close		
WPRCSF60120	120VAC/60Hz Remote Close Kit (Close Coil & Circuit Board)	1
10080505G1	120VAC/60Hz Close Solenoid	1
WPRCSFDC125	125VDC Remote Close Kit (Close Coil & Circuit Board)	1
10080505G4	125VDC Close Solenoid	1
Trip		
10088415G1	Flux Shifter	1
GW108L4XXXRXXXX	New Entelliguard Trip Unit (LSIG)	1
GTP0800U0820	Rating Plug	1
10060051P3	Entelliguard Trip Unit Door	1
Accessories		
WPBASF	Bell Alarm Kit	1
10080044G1	Bell Alarm Module	1
WPS1SF60120	120VAC/60Hz Shunt Trip	1
139C4378G107	120VAC/60Hz Shunt Trip Coil	1
139C4378G113	240VAC/60Hz Shunt Trip Coil	1
WPS1SFDC125	125VDC Shunt Trip	1
139C4378G104	125VDC Shunt Trip Coil	1
139C4378G105	250VDC Shunt Trip Coil	1
10056791G6	125VDC Under Voltage Module	1
WPAUXSF7STG	Aux Switch Assembly (7 stage)	1
WPCTRSFKIT1	Operation Counter	1
10056725G1	Open Fuse Lockout	1




New Replacement Circuit Breaker

WE3DNPGF1XAXXXX

WPX-08, 120VAC, E/O, LSI with Shunt Trip, 4 Stage Aux Switch



Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.



WavePro WP-16
Maintenance Manual - DEH 136
Renewal Parts - DEF 004





Part Number	Description	Qty
Disconnects		
192A9668G1	Primary Disconnect Assembly	6
10080736G1	Breaker Secondary Disconnect	1
0228C8408G003	Equipment Secondary Disconnect	1
Contacts		
568B509G6	Stationary Arcing Contact - Left & Right	6
192A9505G1	Stationary Main Contact	18
192A9511G1	Movable Contact - Left	3
192A9511G2	Movable Contact - Right	3
Charging		
10060164G1	Charging Handle	1
568B596G4	48VDC Charging Motor	1
568B596G5	110VAC/125VDC Charging Motor	1
568B596G6	240VAC/250VDC Charging Motor	1
192A7153P8	Cut-off Switch	1
343L731G1	Ratchet Assembly	1
323A6080G1	Charging Pawl Kit	1
323A6081G1	Holding Pawl Kit	1
Arc Quenchers		
425D404G9	Arc Quencher	3
Racking Mech		
10060041G1	Racking Mechanism	1
10060041G2	Racking Mechanism (OEM)	1

Part Number	Description	Qty
Close		
WPRCSF60120	120VAC/60Hz Remote Close Kit (Close Coil & Circuit Board)	1
10080505G1	120VAC/60Hz Close Solenoid	1
WPRCSFDC125	125VDC Remote Close Kit (Close Coil & Circuit Board)	1
10080505G4	125VDC Close Solenoid	1
Trip		
10088415G1	Flux Shifter	1
GW216L4XXXRXXX	New Entelliguard Trip Unit (LSIG)	1
GTP1600U1640	Rating Plug	1
10060051P3	Entelliguard Trip Unit Door	1
Accessories		
WPBASF	Bell Alarm Kit	1
10080044G1	Bell Alarm Module	1
WPS1SF60120	120VAC/60Hz Shunt Trip	1
139C4378G107	120VAC/60Hz Shunt Trip Coil	1
139C4378G113	240VAC/60Hz Shunt Trip Coil	1
WPS1SFDC125	125VDC Shunt Trip Kit	1
139C4378G104	125VDC Shunt Trip Coil	1
139C4378G105	250VDC Shunt Trip Coil	1
10056791G6	125VDC Under Voltage Module	1
WPAUXSF7STG	Aux Switch Assembly (7 stage)	1
WPCTRSFKIT1	Operation Counter	1
10056725G1	Open Fuse Lockout	1




New Replacement Circuit Breaker

WE2GNPMF1XAXXXX

WPH-16, 120VAC, E/O, LSI with Shunt Trip, 4 Stage Aux Switch






Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.






WavePro WP-32
Maintenance Manual - DEH 136
Renewal Parts - DEF 005

Part Number	Description	Qty
Disconnects		
568B450G1	Primary Disconnects (Lower)	6
139C4549G3	Primary Disconnect (Upper)	6
10080736G1	Breaker Secondary Disconnect	1
0228C8408G003	Equipment Secondary Disconnect	1
Contacts		
K9921572G3	Movable Arcing Contact	9
193A1126G7	Movable Intermediate Contact - Right	3
193A1126G10	Movable Main Contact - Left	9
193A1126G8	Movable Main Contact - Right	6
295B408G3	Stationary Arcing Contact	9
193A1127G1	Stationary Intermediate Contact - Right	3
193A1125G2	Stationary Main Contact - Left	9
193A1125G1	Stationary Main Contact - Right	6
Charging		
10060164G1	Charging Handle	1
568B596G4	48VDC Charging Motor	1
568B596G5	110VAC/125VDC Charging Motor	1
568B596G6	240VAC/250VDC Charging Motor	1
139C4458G1	Cut-off Switch	1
Arc Quenchers		
161D6507G1	Arc Quencher	3
Racking Mech		
10080553G1	Racking Mechanism	1
10080553G3	Racking Mechanism (OEM)	1

Part Number	Description	Qty
Close		
WPRCLF60120	120VAC/60Hz Remote Close Kit (Close Coil & Circuit Board)	1
10080505G1	120VAC/60Hz Close Solenoid	1
WPRCLFDC125	125VDC Remote Close Kit (Close Coil & Circuit Board)	1
10056503P3	125VDC Close Solenoid	1
Trip		
425D385G92	Flux Shifter	1
GW632L4XXXRXXX	New Entelliguard Trip Unit (LSIG)	1
GTP3200U3264	3200A Rating Plug	1
10060051P3	Entelliguard Trip Unit Door	1
Accessories		
WPBALF	Bell Alarm Kit	1
10080044G1	Bell Alarm Module	1
WPS1LF60120	120VAC/60Hz Shunt Trip	1
139C4378G107	120VAC/60Hz Shunt Trip Coil	1
139C4378G113	240VAC/60Hz Shunt Trip Coil	1
WPS1LFDC125	125VDC Shunt Trip Kit	1
139C4378G104	125VDC Shunt Trip Coil	1
139C4378G105	250VDC Shunt Trip Coil	1
WPUVLFDC125	125VDC Under Voltage Device Kit	1
10056951G5	125VDC Under Voltage Module	1
WPAUXLF7STG	Aux Switch Assembly (7 stage)	1
WPCTRLFKIT1	Operation Counter	1
121C2870G3	Open Fuse Lockout	1



Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.



WavePro WP-40
Maintenance Manual -- DEH-137
Renewal Parts - DEF 005

Part Number	Description	Qty
Disconnects		
568B450G2	Primary Disconnects (Lower)	6
139C4549G4	Primary Disconnect (Upper)	6
10080736G1	Breaker Secondary Disconnect	1
0228C8408G005	Equipment Secondary Disconnect	1

Contacts		
K9921572G3	Movable Arcing Contact	15
193A1126G9	Movable Intermediate Contact - Left	3
193A1126G7	Movable Intermediate Contact - Right	3
193A1126G10	Movable Main Contact - Left	9
193A1126G8	Movable Main Contact - Right	9
295B408G3	Stationary Arcing Contact	15
193A1127G2	Stationary Intermediate Contact - Left	3
193A1127G1	Stationary Intermediate Contact - Right	3
193A1125G2	Stationary Main Contact - Left	9
193A1125G1	Stationary Main Contact - Right	9

Charging		
10060164G1	Charging Handle	1
568B596G4	48VDC Charging Motor	1
568B596G5	110VAC/125VDC Charging Motor	1
568B596G6	240VAC/250VDC Charging Motor	1
139C4458G1	Cut-off Switch	1

Arc Quenchers		
161D6507G2	Arc Quencher	3

Part Number	Description	Qty
Close		
WPRCLF60120	120VAC/60Hz Remote Close Kit (Close Coil & Circuit Board)	1
10080505G1	120VAC/60Hz Close Solenoid	1
WPRCLFDC125	125VDC Remote Close Kit (Close Coil & Circuit Board)	1
10080505G4	125VDC Close Solenoid	1

Trip		
425D385G92	Flux Shifter	1
GW740L4XXXRXXXX	New Entelliguard Trip Unit (LSIG)	1
GTP4000U4064	4000A Rating Plug	1
10060051P3	Entelliguard Trip Unit Door	1



Accessories		
WPBALF	Bell Alarm Kit	1
10080044G1	Bell Alarm Module	1
139C4378G107	120VAC/60Hz Shunt Trip Coil	1
139C4378G113	240VAC/60Hz Shunt Trip Coil	1
WPS1LFDC125	125VDC Shunt Trip Kit	1
139C4378G104	125VDC Shunt Trip Coil	1
139C4378G105	250VDC Shunt Trip Coil	1
WPUVLFDC125	125VDC Under Voltage Device Kit	1
WPAUXLF7STG	Aux Switch Assembly (7 stage)	1
WPCTRLFKIT1	Operation Counter	1
121C2870G4	Open Fuse Lockout	1

Racking Mech		
10080553G1	Racking Mechanism	1
10080553G3	Racking Mechanism (OEM)	1



New Replacement Circuit Breaker

WE3NNPVF1XAXXXX

WPX-40, 120VAC, E/O, LSI with Shunt Trip, 4 Stage Aux Switch



Unplanned maintenance is never easy, and finding new OEM parts to complete your repairs on short notice can be costly and time consuming. Which is why we recommend maintaining an on-site supply of the most common breaker parts to assist you in getting your breaker back up and running in the shortest amount of time.



WavePro WP-50
Maintenance Manual - DEH 137
Renewal Parts - DEF 005

Part Number	Description	Qty
Disconnects		
568B450G2	Primary Disconnects (Lower)	6
139C4549G4	Primary Disconnect (Upper)	6
10080736G1	Breaker Secondary Disconnect	1
0228C8408G005	Equipment Secondary Disconnect	1

Contacts		
K9921572G3	Movable Arcing Contact	15
193A1126G9	Movable Intermediate Contact - Left	3
193A1126G7	Movable Intermediate Contact - Right	3
193A1126G10	Movable Main Contact - Left	9
193A1126G8	Movable Main Contact - Right	9
295B408G3	Stationary Arcing Contact	15
193A1127G2	Stationary Intermediate Contact - Left	3
193A1127G1	Stationary Intermediate Contact - Right	3
193A1125G2	Stationary Main Contact - Left	9
193A1125G1	Stationary Main Contact - Right	9

Charging		
10060164G1	Charging Handle	1
568B596G4	48VDC Charging Motor	1
568B596G5	110VAC/125VDC Charging Motor	1
568B596G6	240VAC/250VDC Charging Motor	1
139C4458G1	Cut-off Switch	1

Arc Quenchers		
161D6507G2	Arc Quencher	3

Part Number	Description	Qty
Close		
WPRCLF60120	120VAC/60Hz Remote Close Kit (Close Coil & Circuit Board)	1
10080505G1	120VAC/60Hz Close Solenoid	1
WPRCLFDC125	125VDC Remote Close Kit (Close Coil & Circuit Board)	1
10080505G4	125VDC Close Solenoid	1

Trip		
425D385G93	Flux Shifter	1
GW850L4XXXRXXXX	New Entelliguard Trip Unit (LSIG)	1
GTP5000U5064	5000A Rating Plug	1
10060051P3	Entelliguard Trip Unit Door	1

Accessories		
WPBALF	Bell Alarm Kit	1
10080044G1	Bell Alarm Module	1
WPS1LF60120	120VAC/60Hz Shunt Trip	1
139C4378G107	120VAC/60Hz Shunt Trip Coil	1
139C4378G113	240VAC/60Hz Shunt Trip Coil	1
WPS1LFDC125	125VDC Shunt Trip Kit	1
139C4378G104	125VDC Shunt Trip Coil	1
139C4378G105	250VDC Shunt Trip Coil	1
WPUVLFDC125	125VDC Under Voltage Device Kit	1
WPAUXXF7STG	Aux Switch Assembly (7 stage)	1
WPCTRLFKIT1	Operation Counter	1
121C2870G4	Open Fuse Lockout	1

Racking Mech		
10080553G2	Racking Mechanism	1
10080553G4	Racking Mechanism (OEM)	1

New Replacement Circuit Breaker

WE3RNPWF1XAXXXX

WPX-50, 120VAC, E/O, LSI with Shunt Trip, 4 Stage Aux Switch

